


PERFORMANCE VALUES FOR DRYWALL CEILINGS


Heating and cooling ceiling
with OPTIPANEL 15 with integrated capillary tube mat OPTIMAT GB 15
with OPTIPANEL 18 with integrated capillary tube mat OPTIMAT GB 18



SPECIFIC COOLING CAPACITY ACC. TO DIN EN 14240

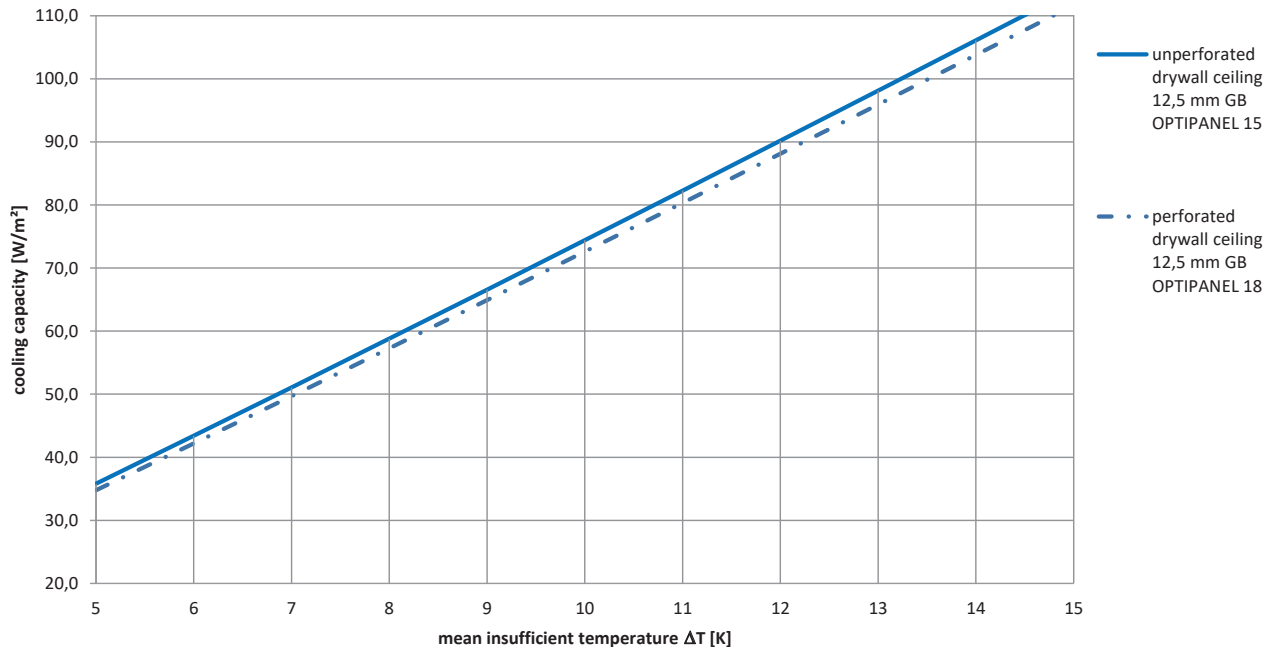

SPECIFIC HEATING CAPACITY ACC. TO DIN EN 14240 / 14037-5 (DRAFT)

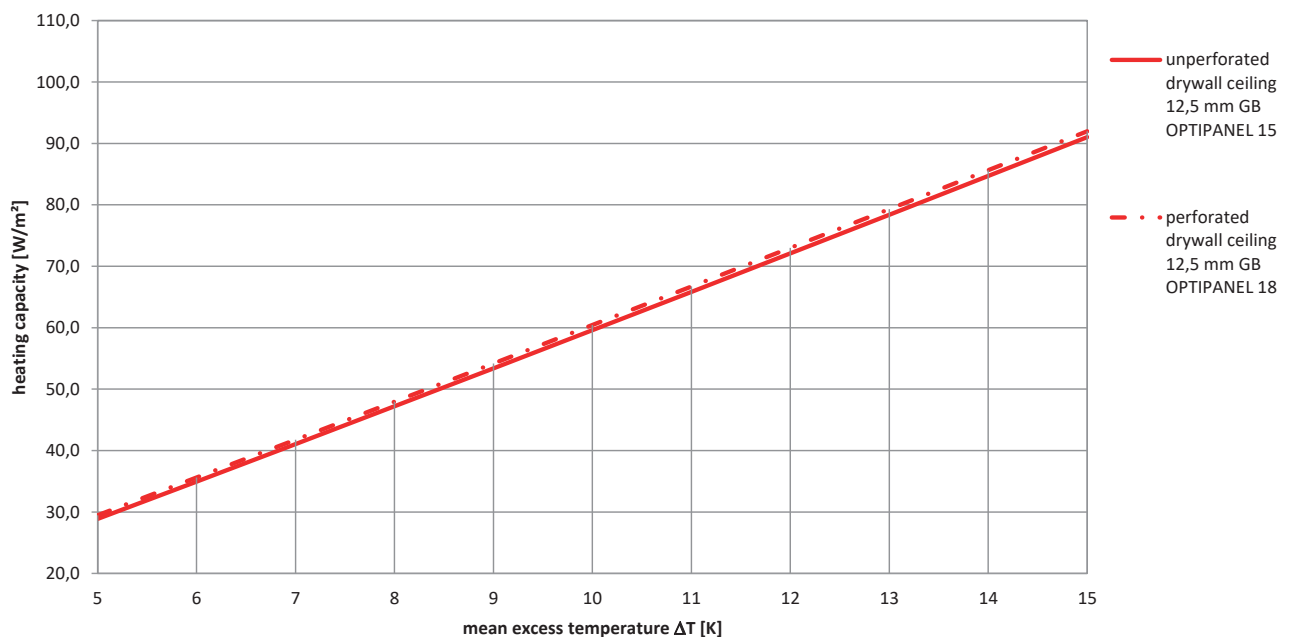

CONTACT

Clina Heiz- und Kühlelemente GmbH
Lübarser Straße 40 - 46 | 13435 Berlin

Fon: + 49 30 402054 – 0
Fax: + 49 30 402054 – 19

www.clina.de
info@clina.de